




Replacement instruction – OUTPUT MODULE OPM-1

Placement of I/O addr./ jumpers OPM-1 DELOMATIC

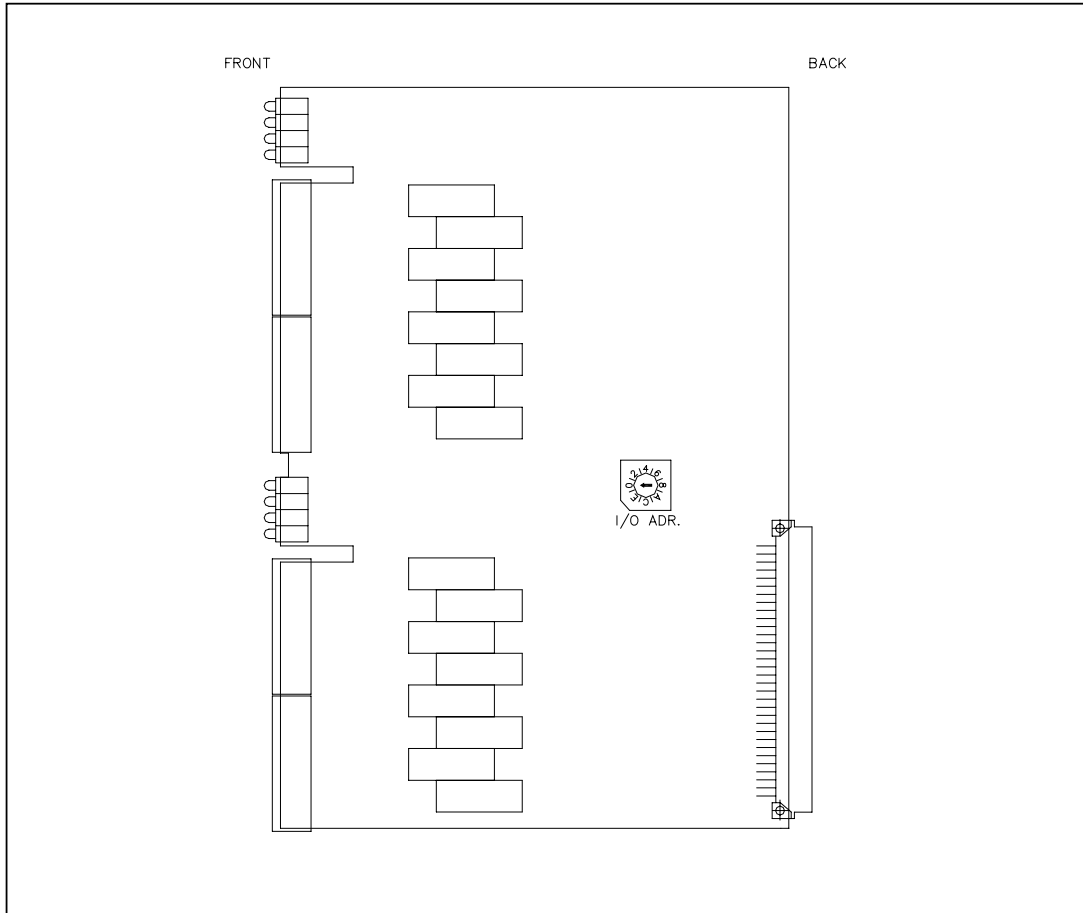

DIP switches:

The I/O address for the backplane bus is to be set. Notice that all OPM-1 modules must have different I/O addresses starting with number zero (null). The number sequence can be interrupted. The I/O address is set by the I/O address-switch.

Handle:

For replacement notice that the replacement unit is given same I/O address as the unit to be replaced.